


### **AMENDMENT TO THE DRAWINGS**

FIGS. 6, 6, 7A, 7B, 8A, 8B, 15-23, 30 and 31 have been canceled. The remaining Figures have been renumbered accordingly. Further, new FIGS. 21-23 are added. The proposed changes are attached in Appendix A. Applicant respectfully requests the Examiner to approve the drawings.



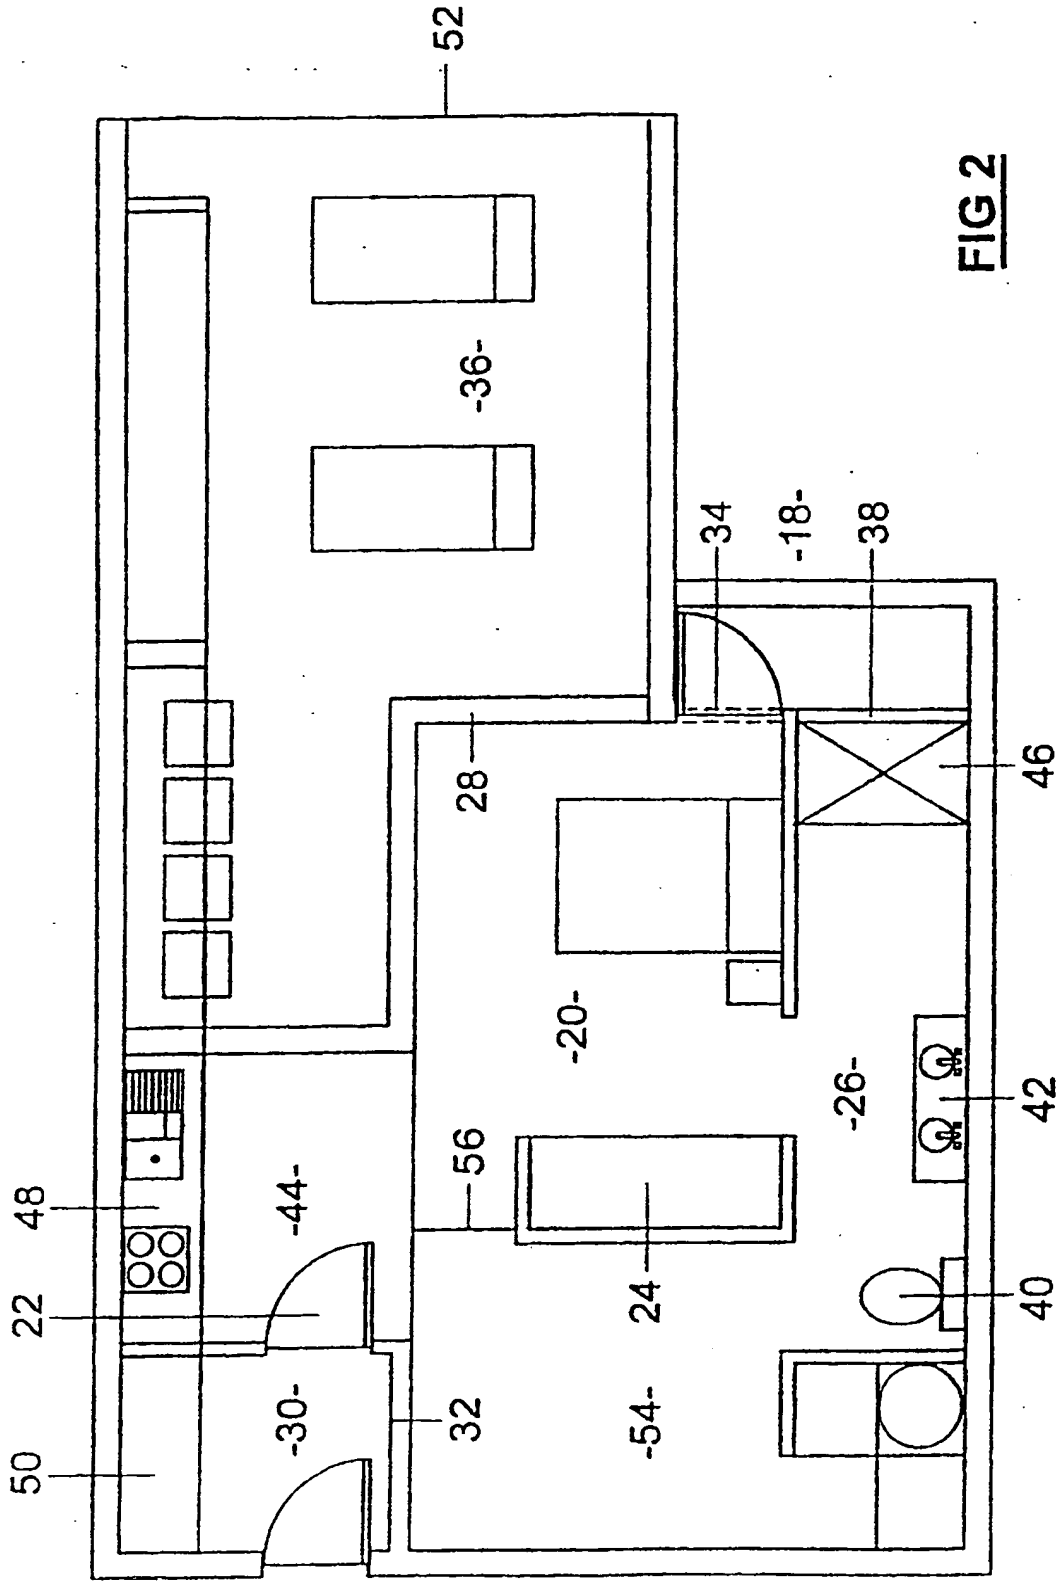

**FIG 2**

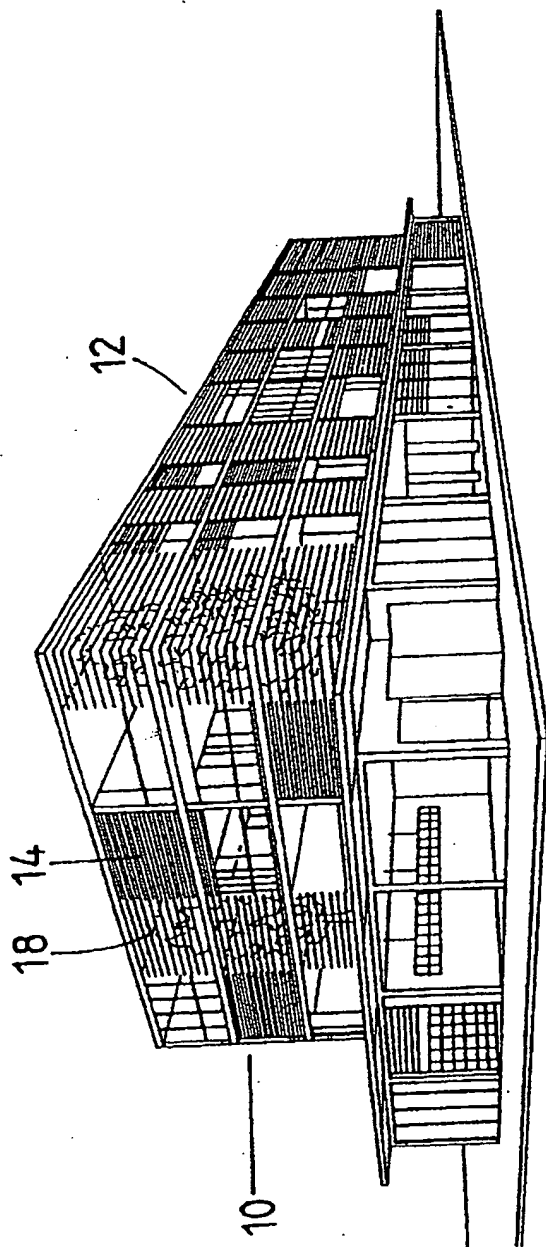



FIG 3




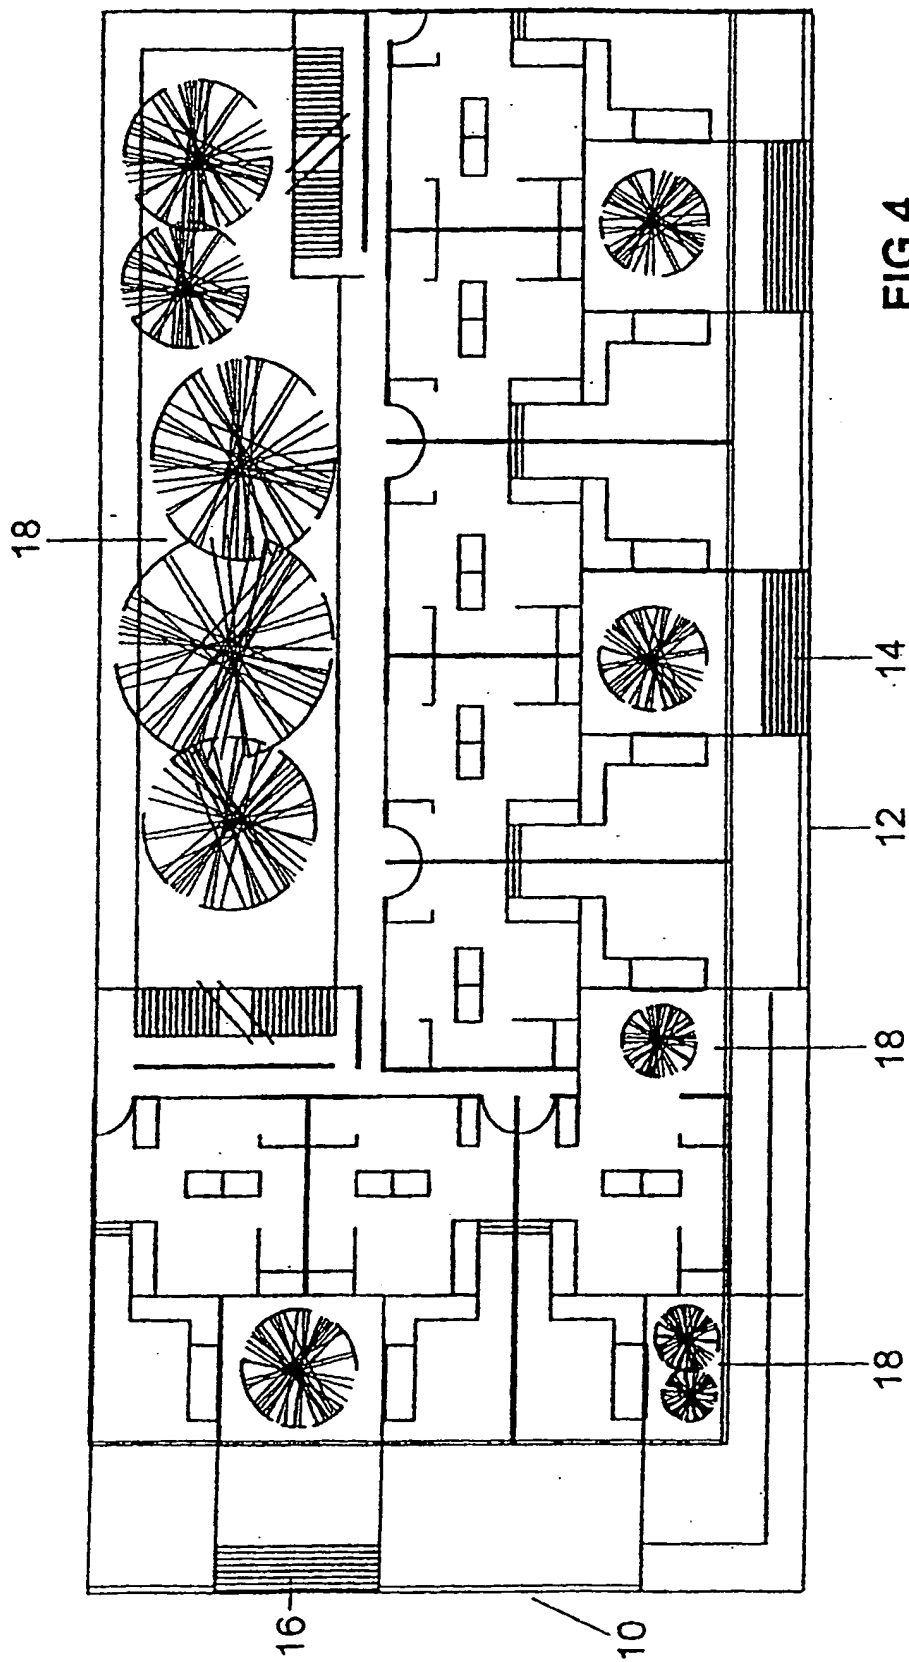


FIG 4

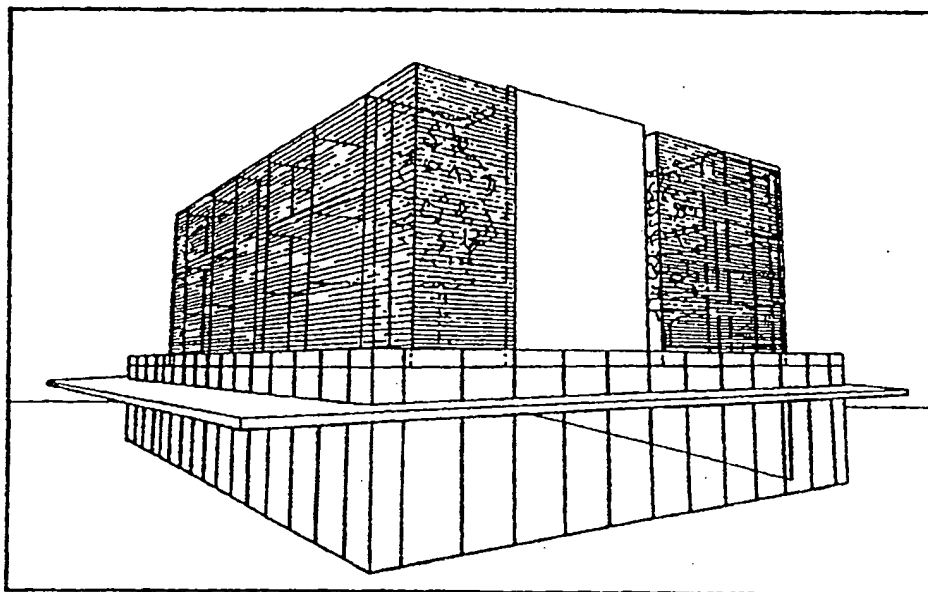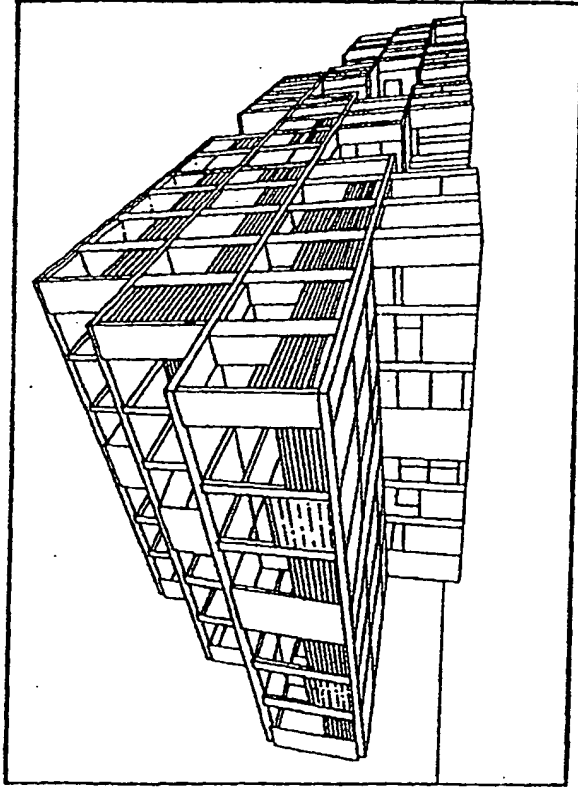

Fixed Module

FIG 5A

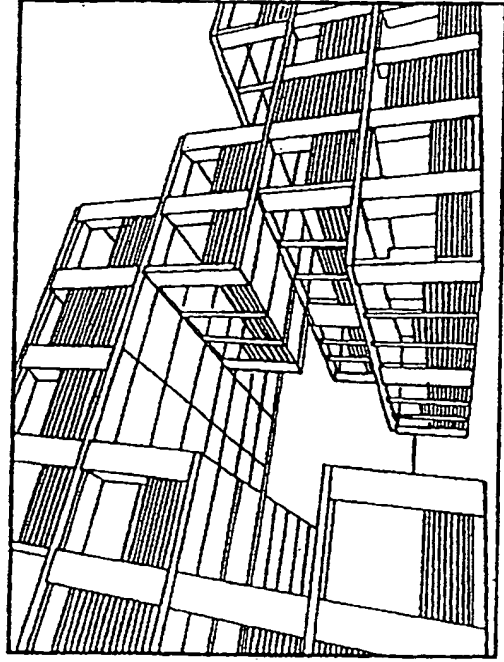


**Mobile Module**

**FIG 5B**




OFFICE

FIG 7

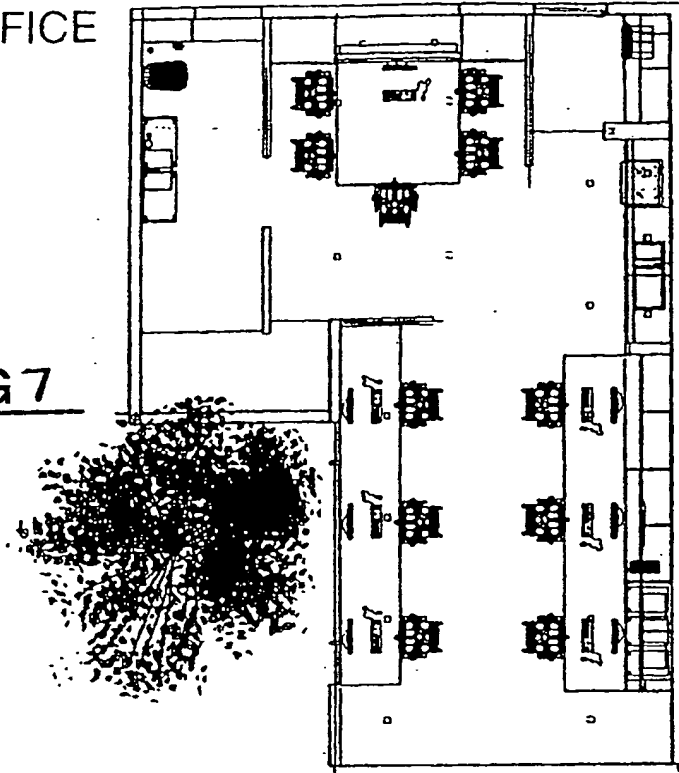


LIVING

FIG 6

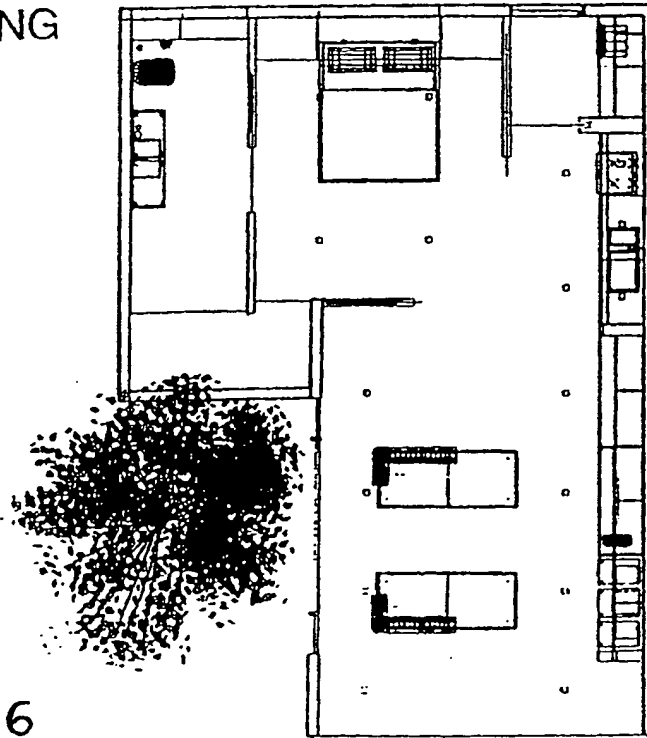





## Schematic Illustration of the Power and Air Conditioning Systems

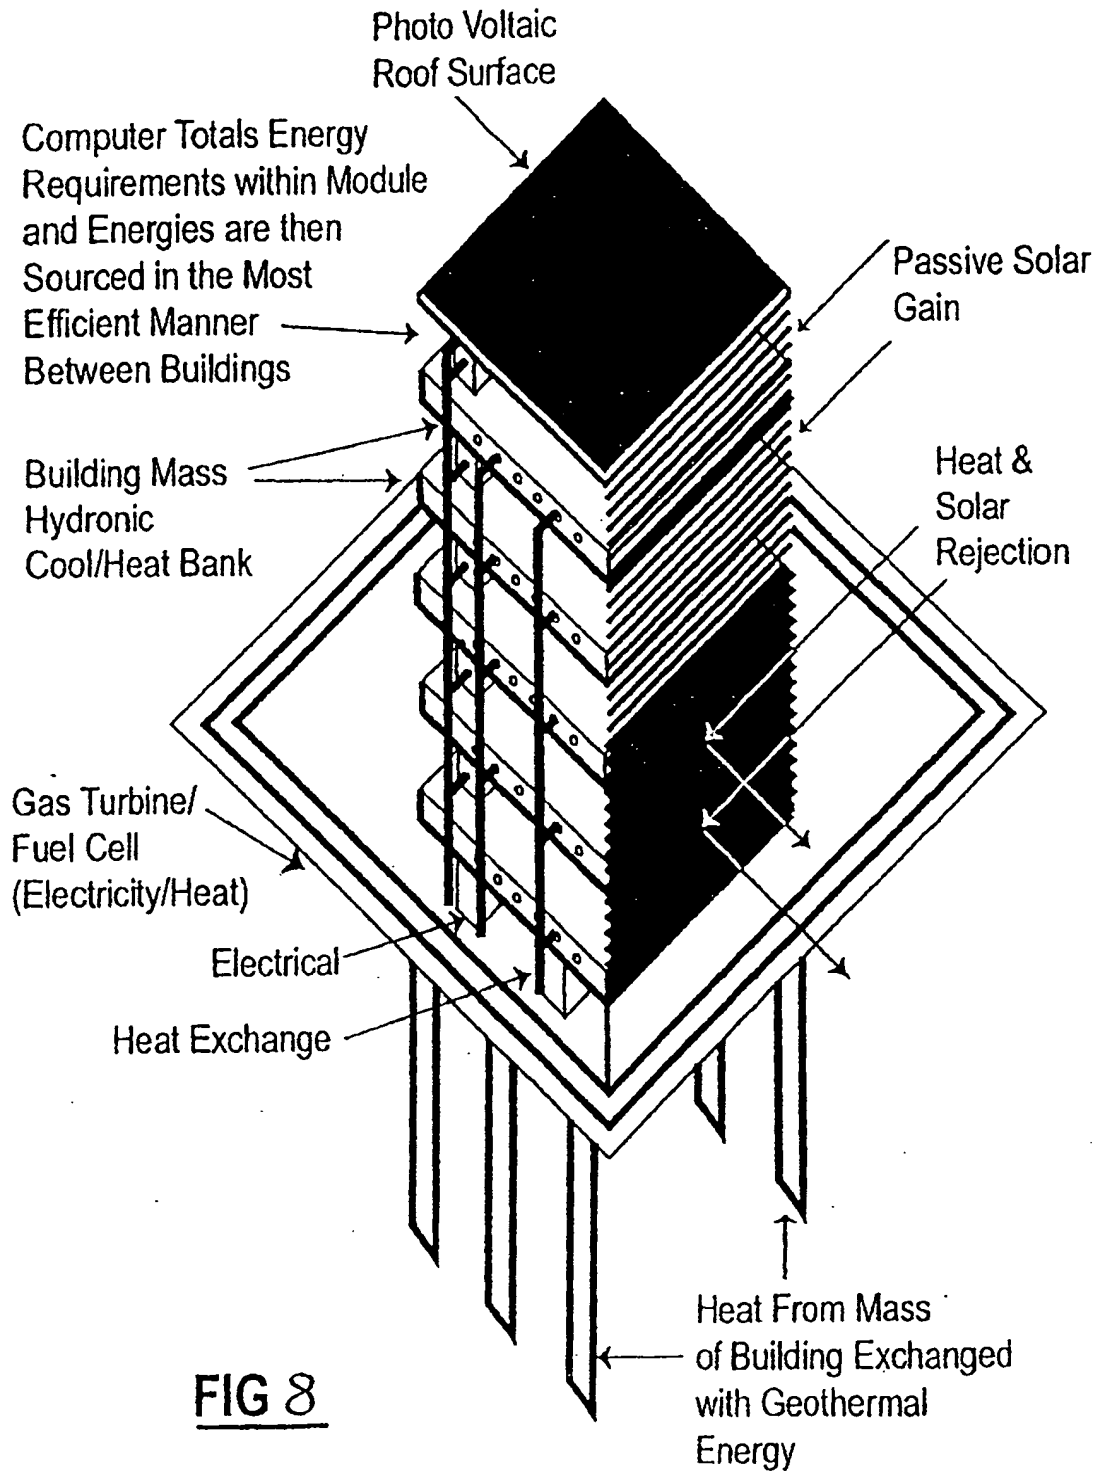

**FIG 8**




## Schematic Illustration of the Natural Air Handling System

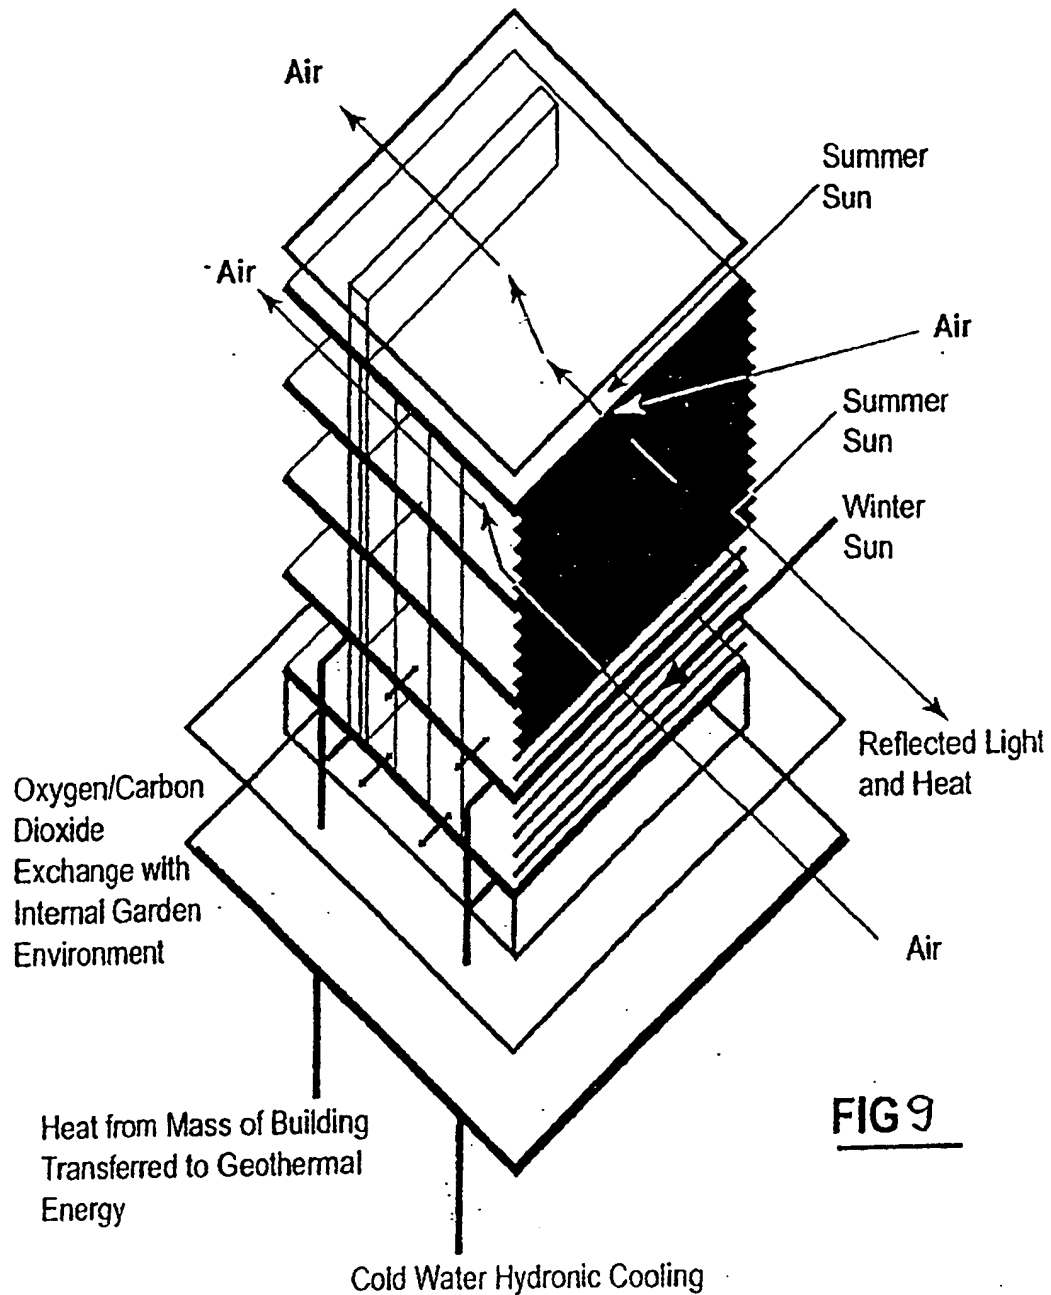




## Schematic Illustration of the Hot Water Loom System

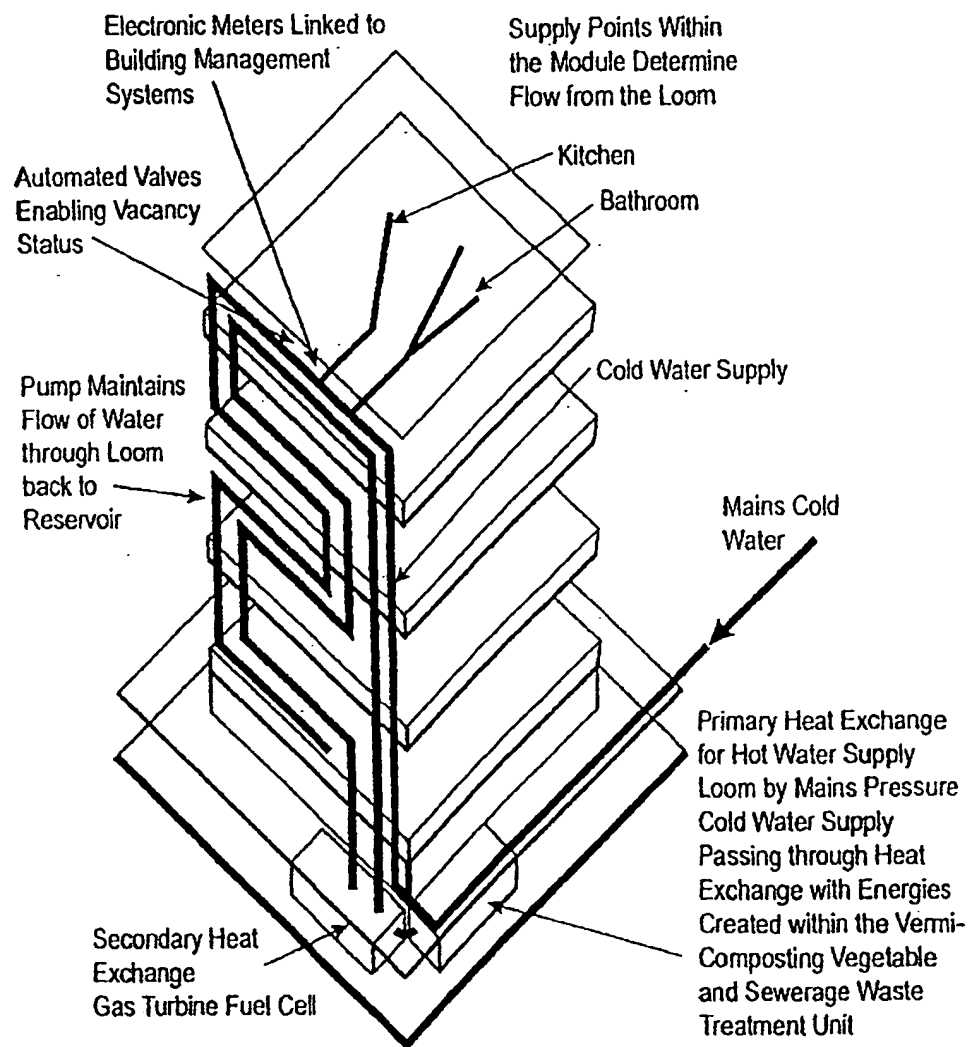

A Series of Standardised Ceiling Panels Located Within the Common Area Create Accessible Services Duct for Placement of Hydraulic Electrical and Data Looms. Electrical Meters Switches Valves and Pumps are Networked to the Building Management Computer which Interactively Process the Data for Efficient Sourcing Supply and for Accounting Purposes.

**FIG 10**


## Schematic Illustration of Water Collection and Reticulated Reuse System

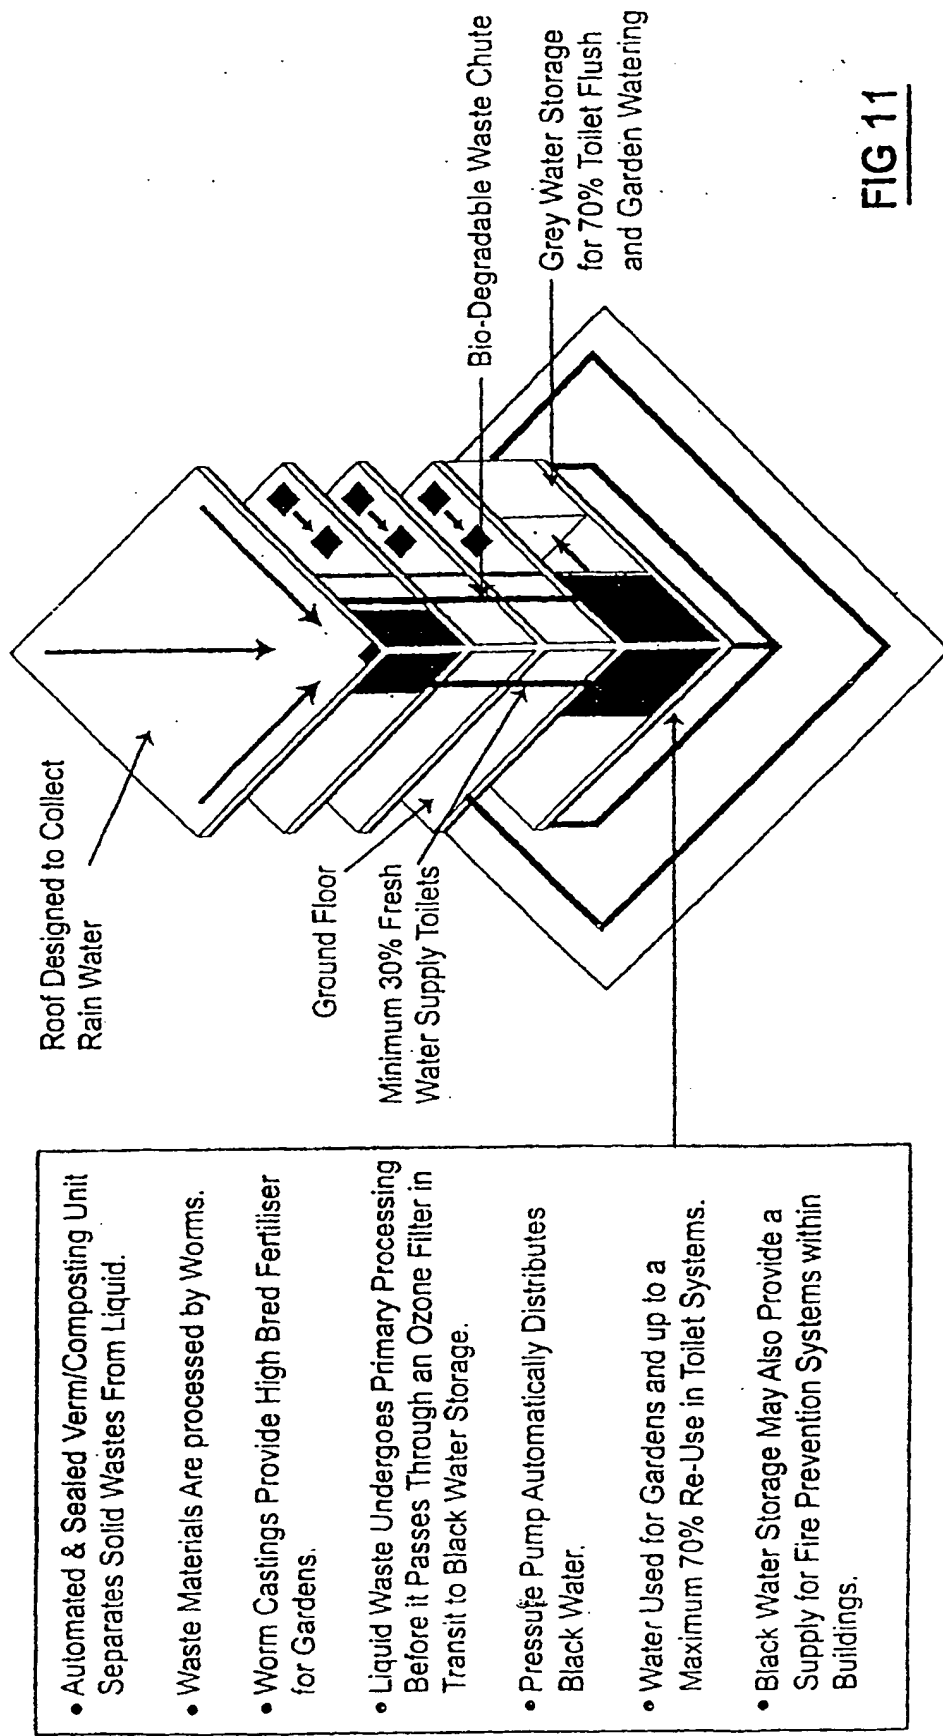

**FIG 11**



## Schematic Illustration of the Closed Loop Air-Conditioning Energy Exchange

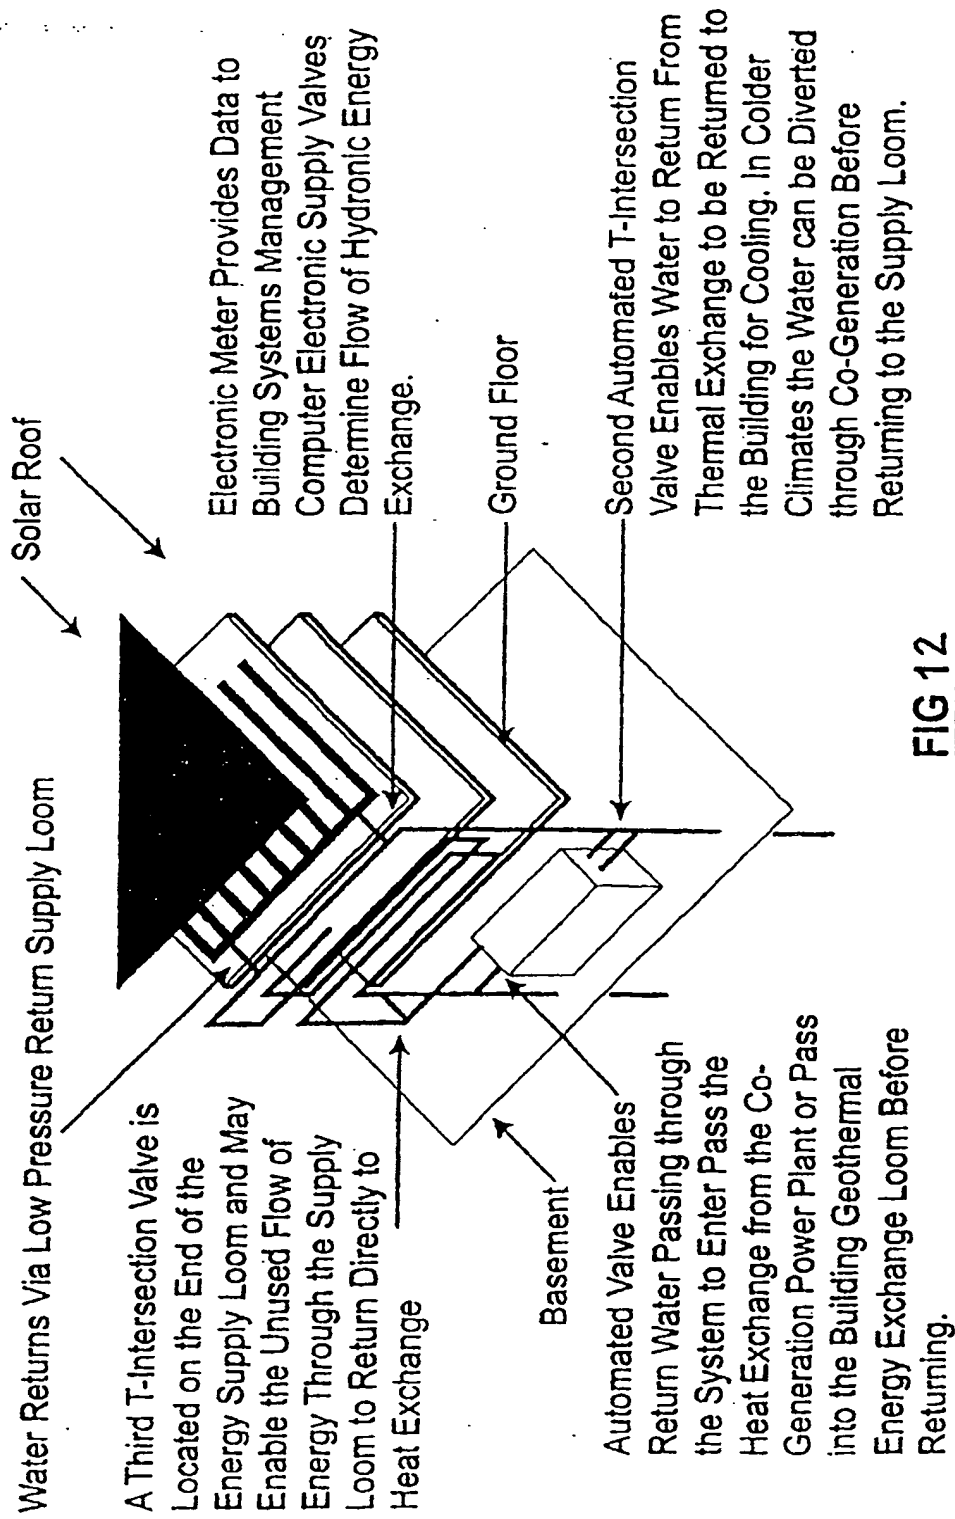

**FIG 12**

O I P E J C 9 5  
OCT 0 5 2004  
PATENT & TRADEMARK OFFICE





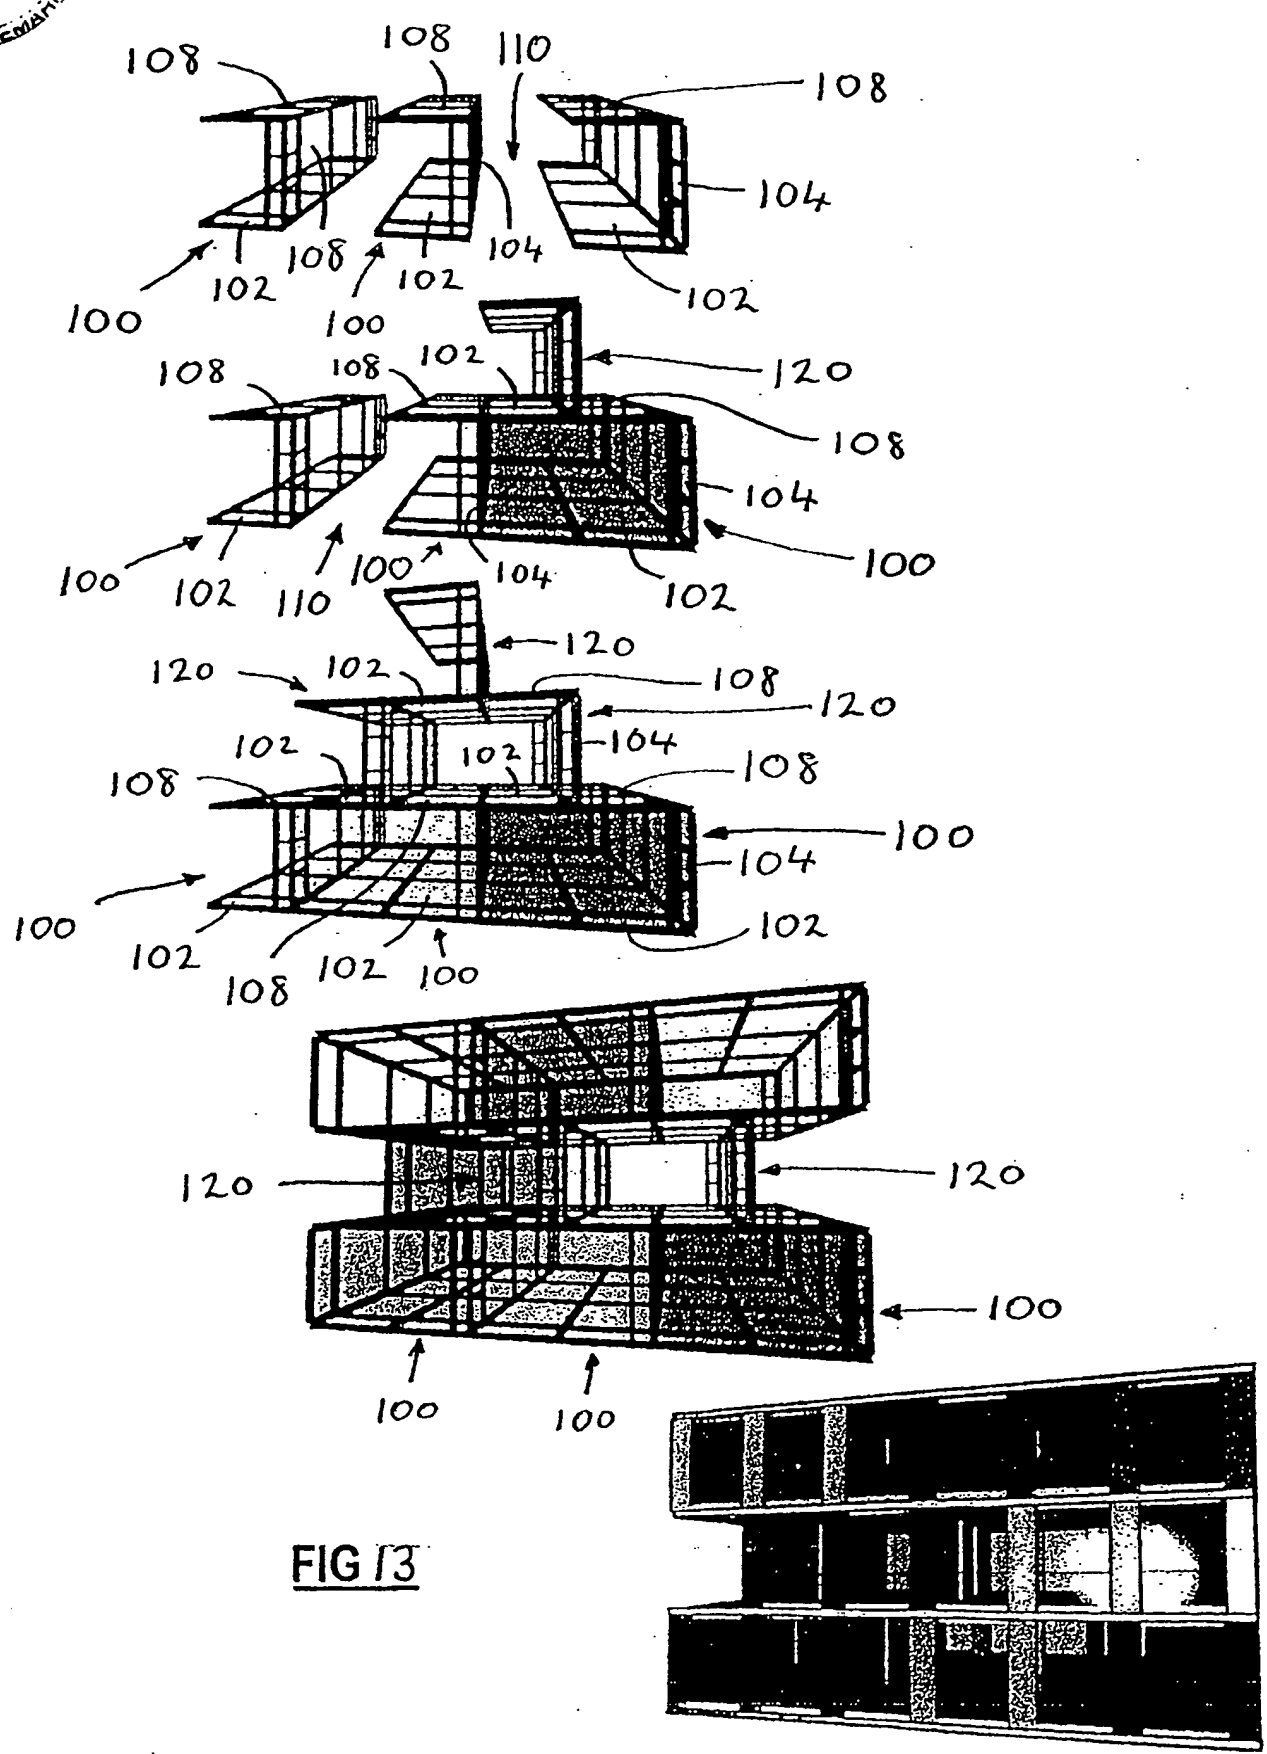



FIG 13

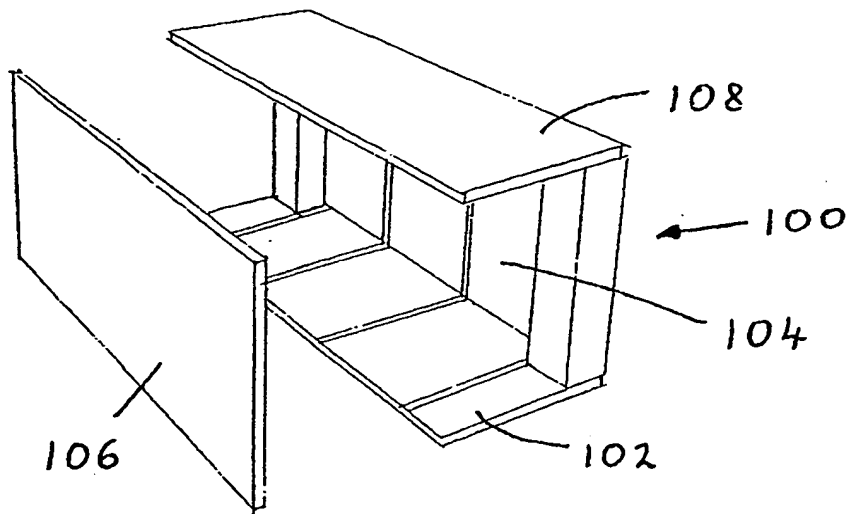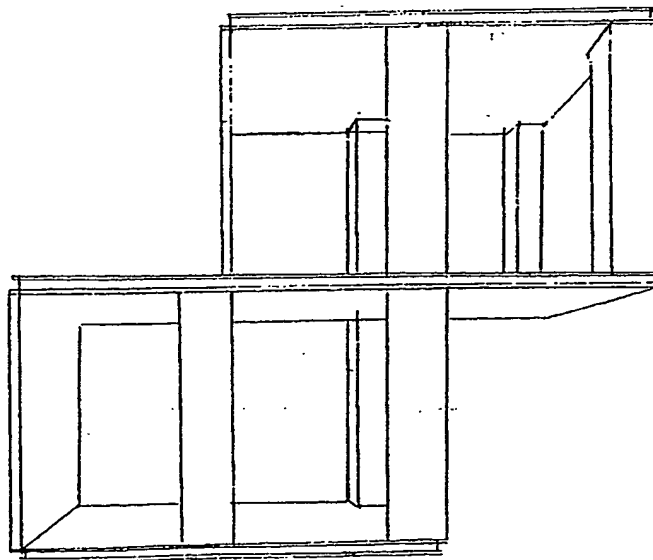


**FIG 14**

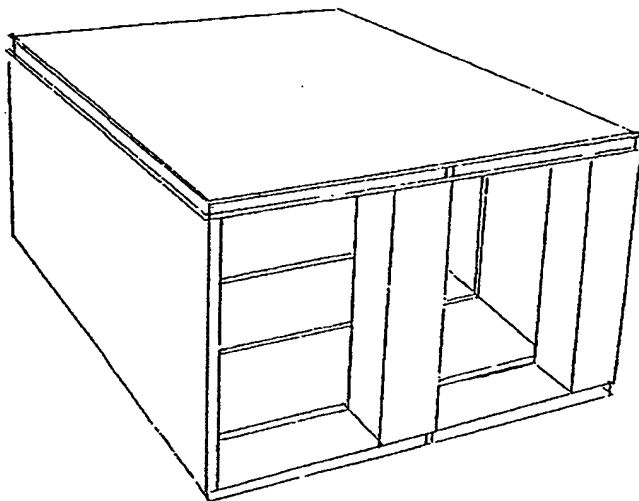

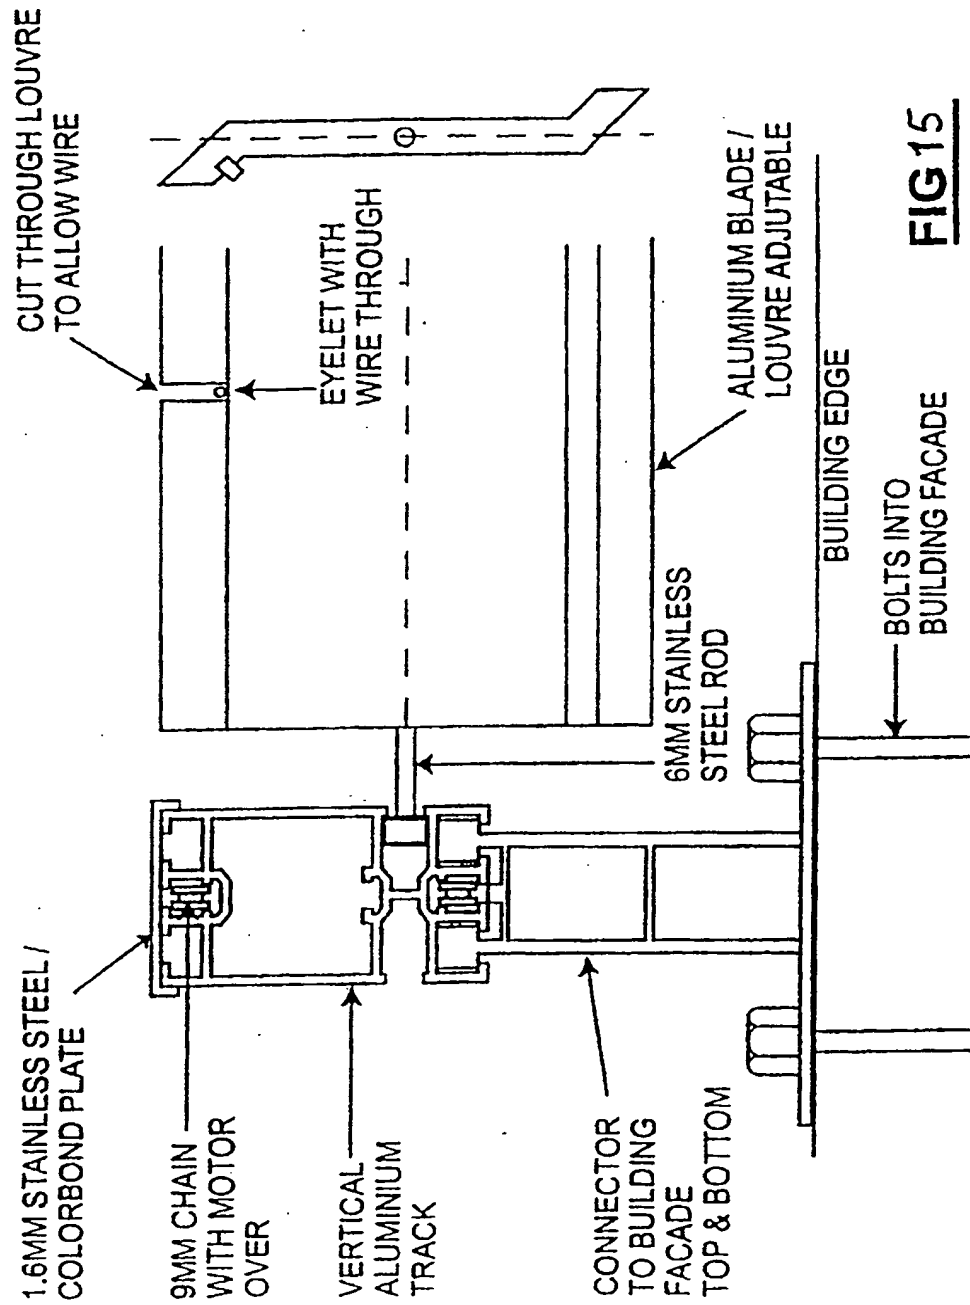


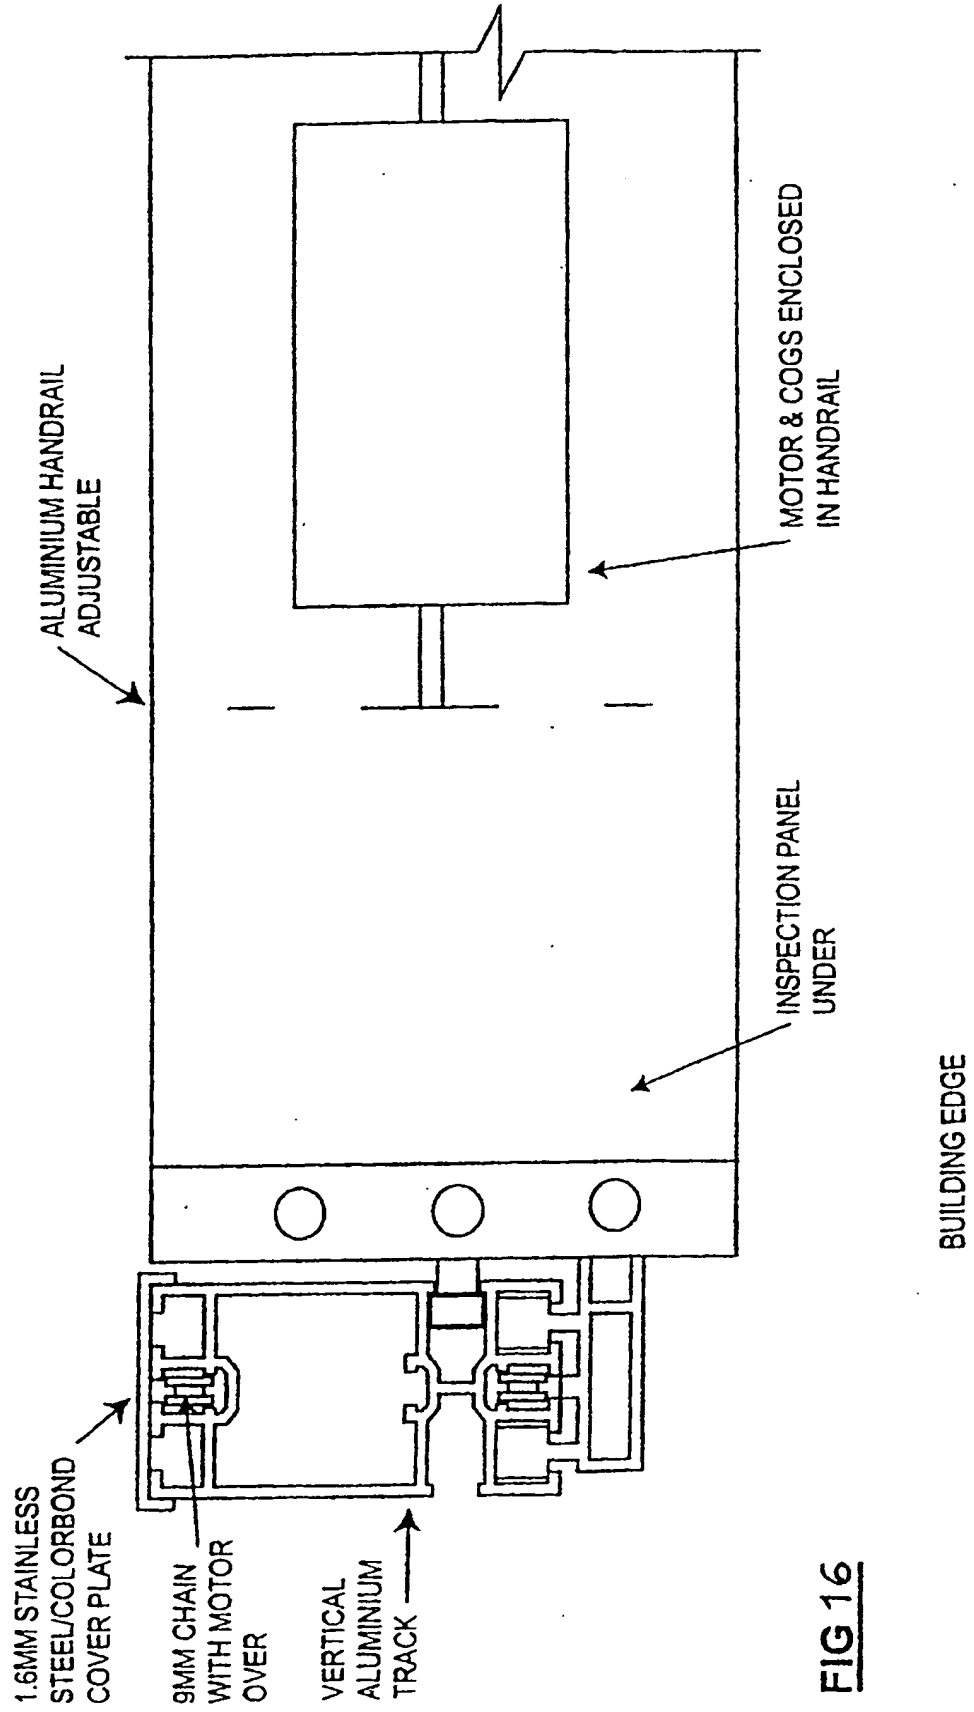


**FIG 16**

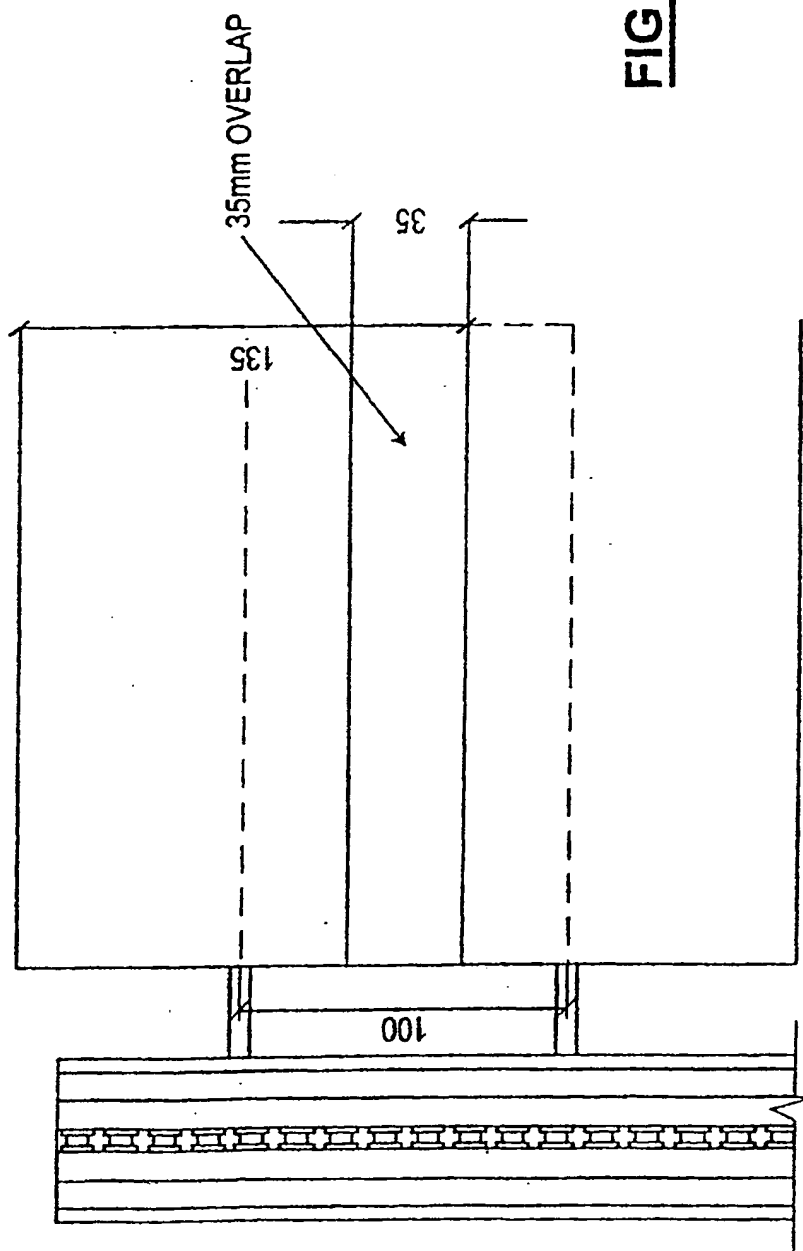


**FIG17**

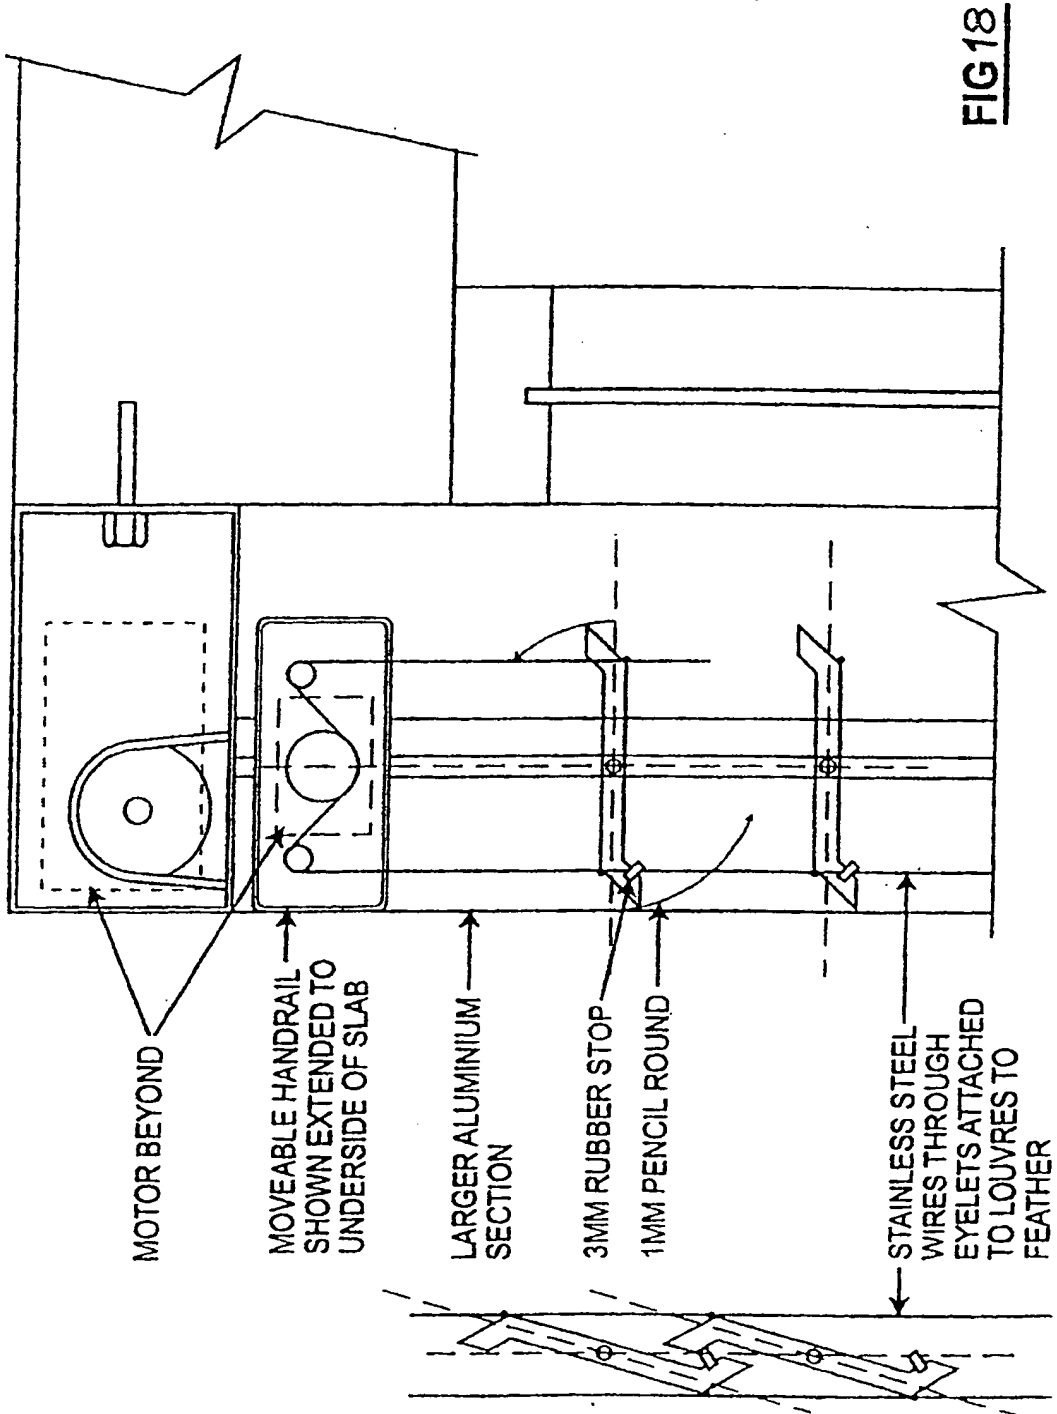


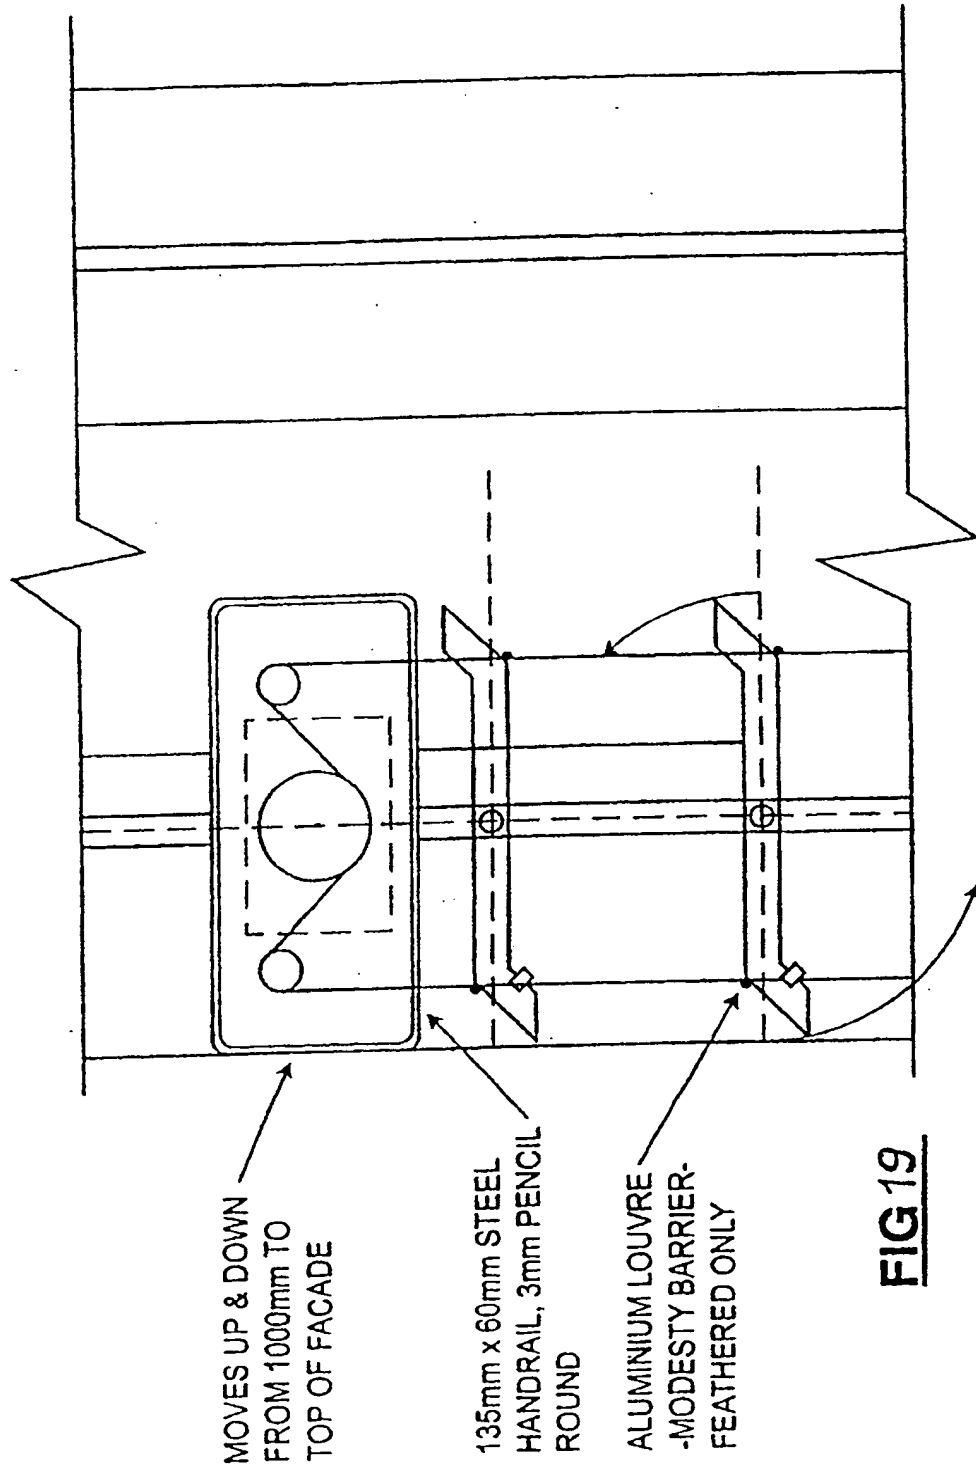


**FIG 19**

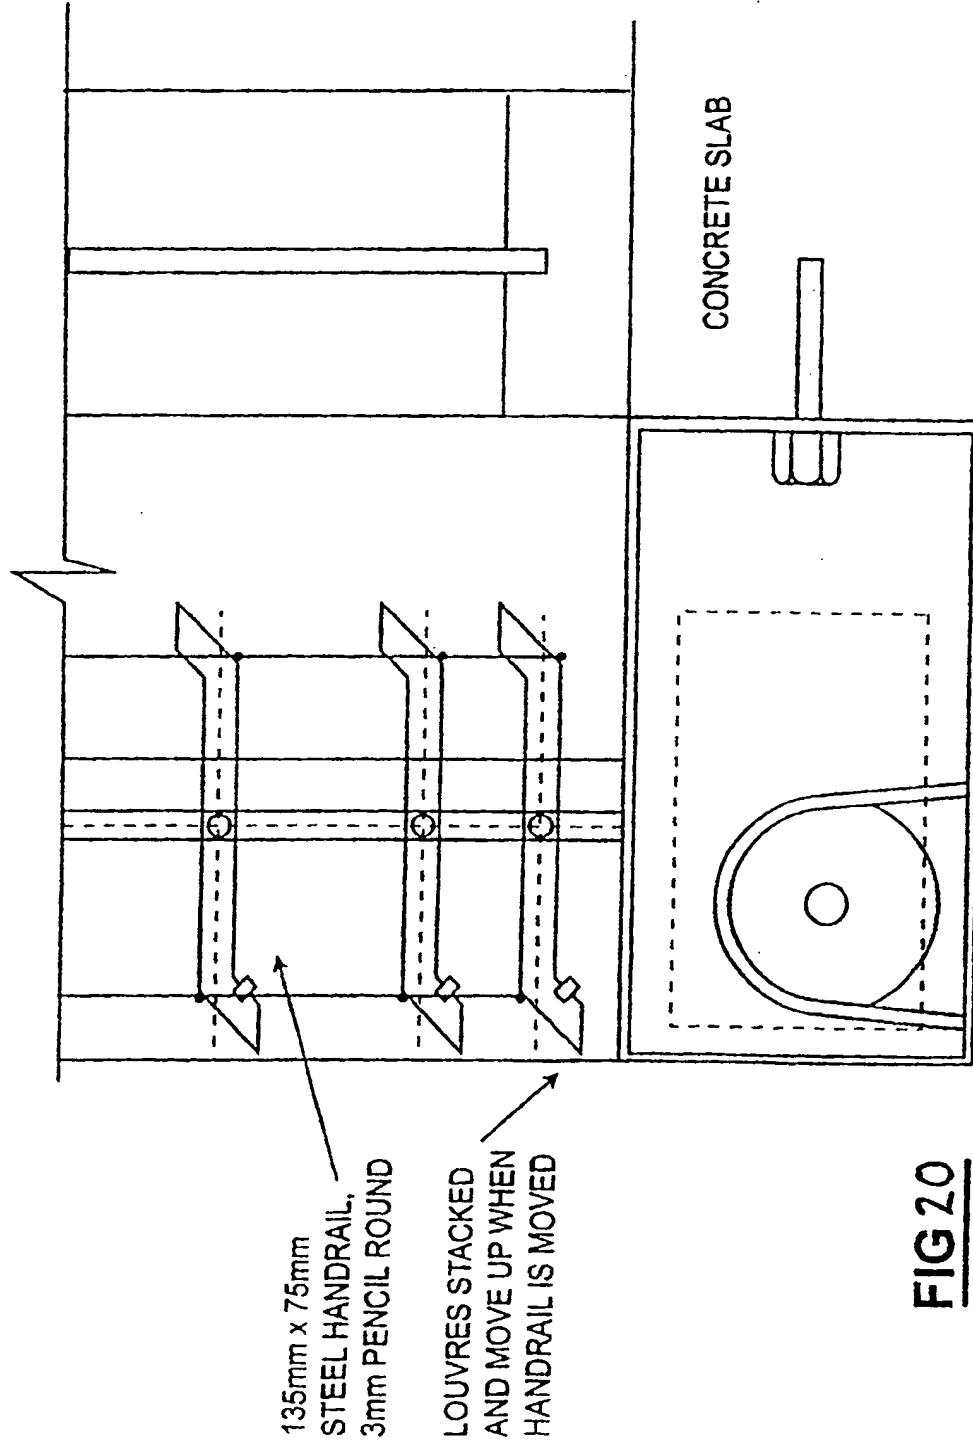

**FIG 20**

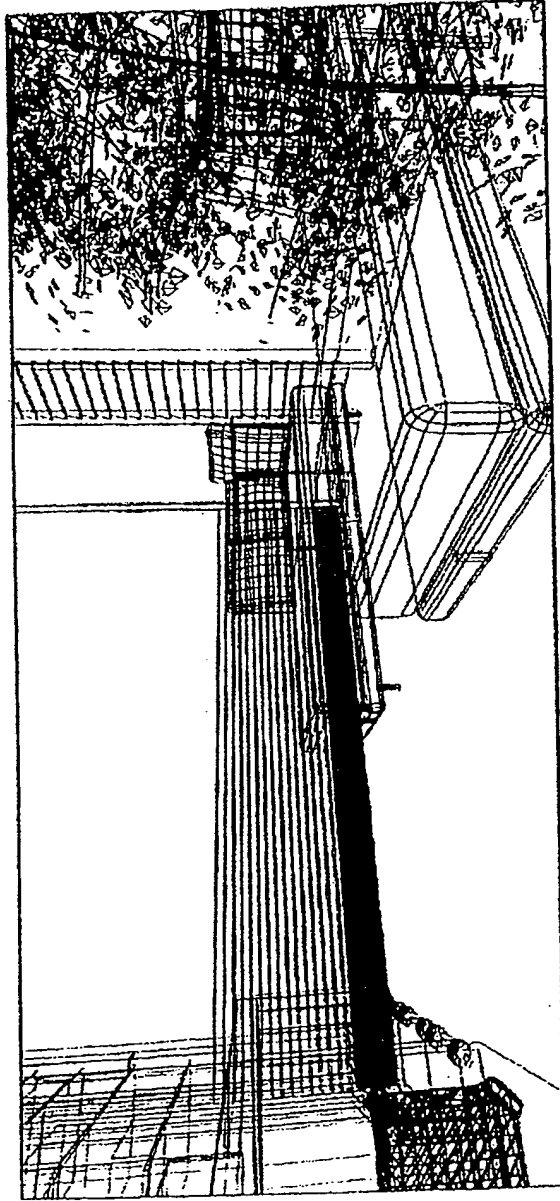

**FIG 21**

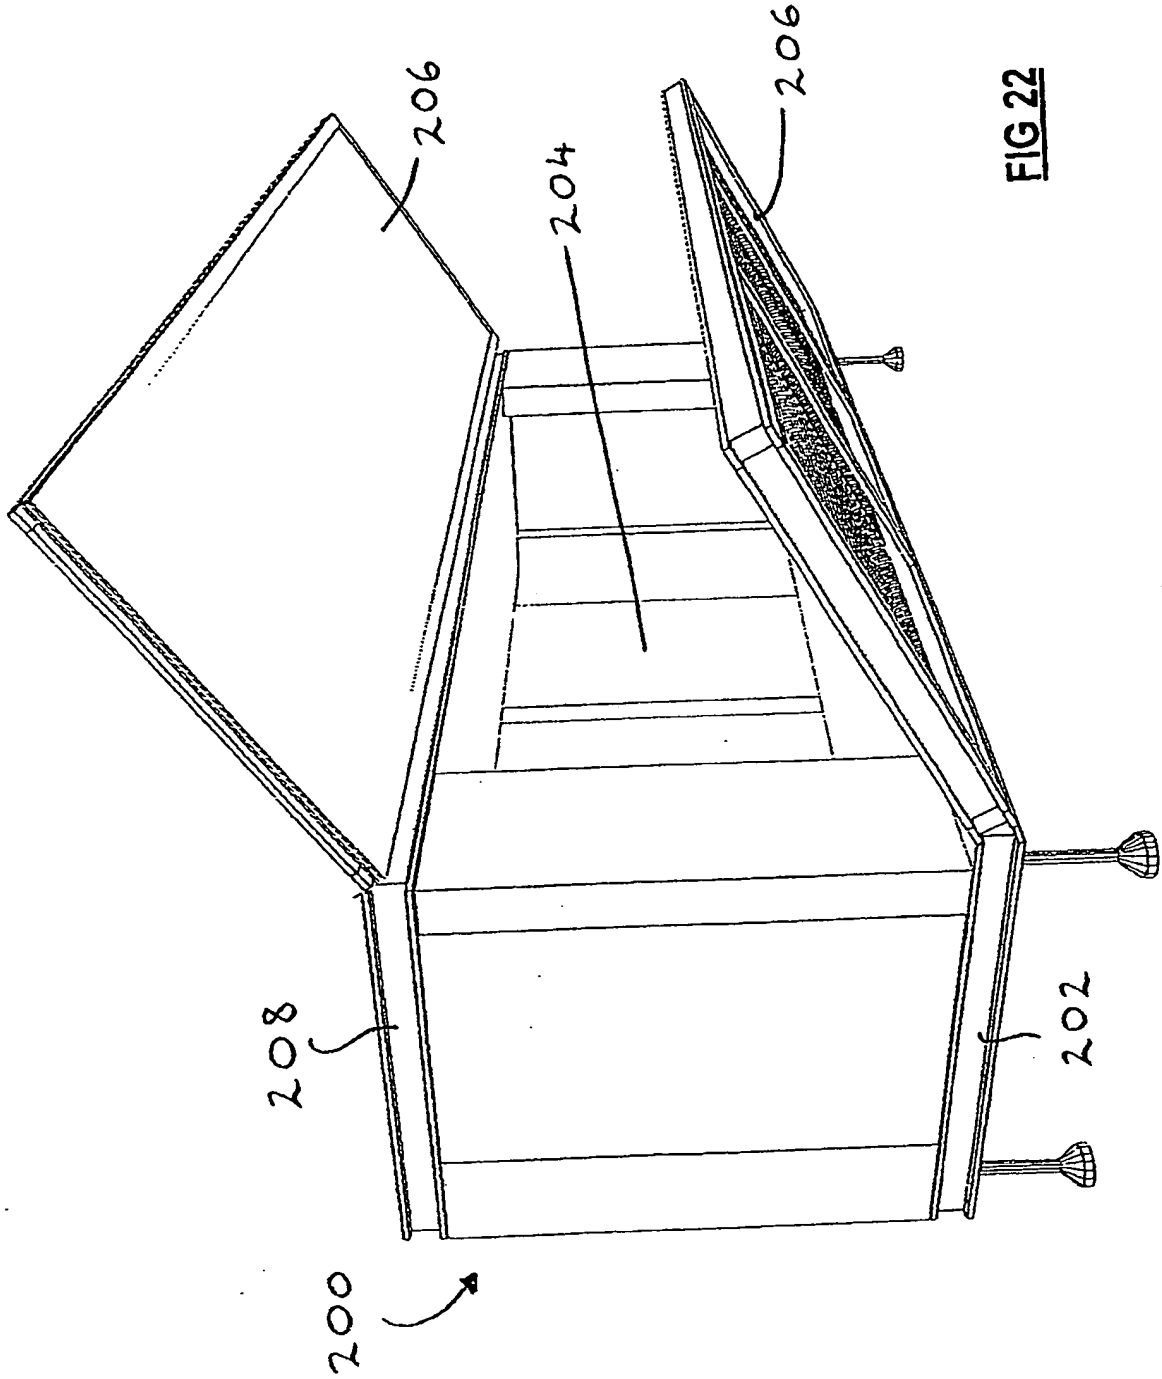

**FIG 22**

